

# Lindab **FRA**

Flow measuring unit - rectangular



# Flow measuring unit-rectangular

# FRA



## Description

FRA is a measuring unit with a measuring cross used for measuring volume air flow rate in rectangular duct systems.

FRA is equipped with a regulator, providing an output signal that is proportional to the volume air flow rate. FRA can be used to monitor the actual airflow or can be used to control a volume flow regulator.

Regulators comes with either flow sensor (D3) for clean air or membrane sensor (M1) for contaminated air.

The FRA needs a certain distance of straight duct before the unit and this has to be observed to obtain a stable and accurate air flow regulation.

To avoid clogging of the measuring cross, it is recommended to use VRU only in applications with clean air, meaning free of dust, particles and similar.


- Belimo MP, Modbus, BACnet & analogue control 0(2)-10V.
- Integrated NFC interface, compatible with Belimo Assistant App.
- Tightness class B according to EN1751.

## Order code

<b>Product</b>	<b>FRA</b>	<b>aaa x bbb</b>	<b>cc</b>	<b>dddd</b>
<b>Type</b>	FRA			
<b>Dimension</b>	Min. : a x b = 200 x 100 mm Max. : a + b ≤ 2400 mm and a ≤ 1500 mm			
<b>Regulator</b>	D D3 dynamic flow sensor M M1 membrane sensor			
<b>Flange type</b>	LS RJFP 20 (Standard All sizes ) RJFP 30 When a or b > 800 RJFP 40 On request			

Example: FRA-500x200-M1-RJFP 20

## Dimensions

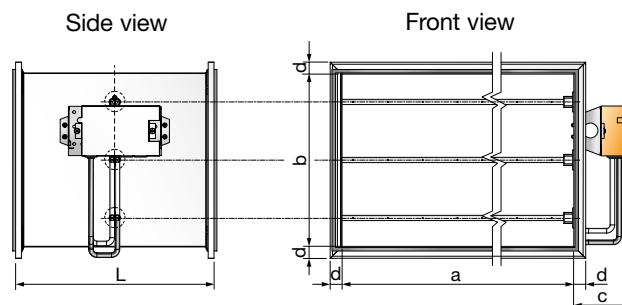

**NB!** Different flange types are available, see order code and dimension table below.  
a and b dimensions, see order code.

## Dimension table

Flange type	d mm	L mm	c mm
LS	20	341	106
RJFP20	20	341	
RJFP30	30	342	
RJFP40	40	343	

## Installation

Using LS-profile. Installation instruction, please go to Assembly instruction, Rectangular air duct systems, [LS-profile](#).

Using RJFP-profiles. Installation instruction, please go to Lindab rectangular duct systems, [RJFP](#).

You can find general information about air duct systems, theory calculations following this [link](#).

## Regulator type table

Type	Regulator
FRA-D	VRU-D3-BAC
FRA-M	VRU-M1-BAC

## Belimo documentation

For Belimo motor documentation, visit and read more on Belimo's homepage: [Belimo Universal](#)

# Flow measuring unit-rectangular

# FRA

## Technical data

### Volume flow measurement


The accuracy of volume flow measurement depends on the flow conditions in front of the measuring cross. It is preferable to have a long straight duct section in front of the measuring point, according to the table below.

If these recommendations are not followed, it will cause an unstable flow measurement and therefore higher inaccuracy in the regulation of the required air flow.


Components	Recommended straight duct before unit
Bend	3 x d <sub>h</sub> *
Tee-piece	4 x d <sub>h</sub> *
Damper	6 x d <sub>h</sub> *

d<sub>h</sub> \* is the hydraulic diameter for a rectangular duct (and FRA), d<sub>h</sub> can be calculated by using FRA dimension a and b:

$$d_h^* = 2 \times a \times b / (a + b)$$

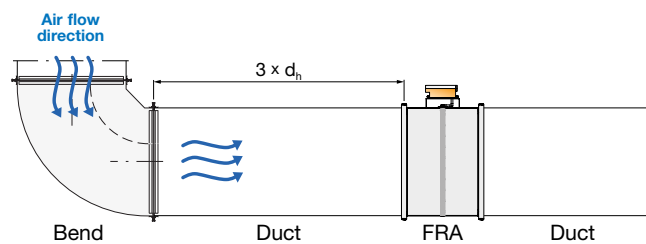

Example above showing top view of recommended straight duct distance between duct bend and a FRA.

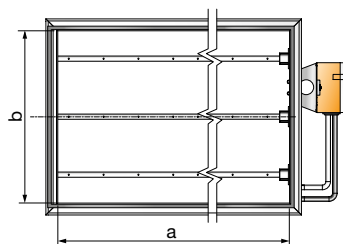

Front view of FRA and dimension a and b.

## Flow measuring unit-rectangular

## FRA

## Technical data

## Settings

$V_{nom}$  indicates the measuring range for the actuator. A standard FRA is calibrated to a  $V_{nom}$  of 7 m/s according to the table below.

In special cases the FRA can be set to a higher  $V_{nom}$ , e.g. 10 m/s.

The output signal from Belimo VAV universal is linear between 2 -10 V which corresponds to a flow between 0 and  $V_{nom}$ .

Air flows corresponding to air velocities below 1.0 m/s will result in a 2 V signal.

FRA<sub>nom</sub> and measuring limit.

Size mm			Measuring limit = 1 m/s		(Standard) $V_{nom} = 7$ m/s		$V_{nom} = 10$ m/s	
a	x	b	m <sup>3</sup> /h	l/s	m <sup>3</sup> /h	l/s	m <sup>3</sup> /h	l/s
300		200	216	60	1512	420	2160	600
400		200	288	80	2016	560	2880	800
		300	432	120	3024	840	4320	1200
500		200	360	100	2520	700	3600	1000
		300	540	150	3780	1050	5400	1500
		400	720	200	5040	1400	7200	2000
600		500	900	250	6300	1750	9000	2500
		200	432	120	3024	840	4320	1200
		300	648	180	4536	1260	6480	1800
		400	864	240	6048	1680	8640	2400
800		500	1080	300	7560	2100	10800	3000
		200	576	160	4032	1120	5760	1600
		300	864	240	6048	1680	8640	2400
		400	1152	320	8064	2240	11520	3200
1000		500	1440	400	10080	2800	14400	4000
		300	1080	300	7560	2100	10800	3000
		400	1440	400	10080	2800	14400	4000
		500	1800	500	12600	3500	18000	5000
	600	2160	600	15120	4200	21600	6000	

# Flow measuring unit-rectangular

# FRA

## Belimo information

Find all information and download here: [Belimo](#)

### Key features:

- Check and modify device setting parameters
- Display identification data: Device type, position, designation, serial number, bus address
- Addressing (MP-Bus, BACnet, Modbus, TCP/IP)
- "Setup": Guided parameter setup for your device
- "Copy/Paste Configuration": Replicate settings for the same device types
- "Live trend": Perform local override and live trending with the easyshare function
- "Health": Monitor device operation KPIs. E.g. Power supply, Bus state, Sensor state, etc.
- "Reports": Retrieve digital reports of your device with the easy-share function. E.g. Calibration certificate, Commissioning report
- "Export Configuration": Create a logfile with the easy-share function -
- In-app language adjustment (EN/DE/FR/IT/ES/CN/RU)
- Platform-independent for Android, Apple iOS, and Windows



### Smartphone/ Tablet



### PC



- 1) LINK.10 is needed for Bluetooth and USB connection. It is recommended for more extended use and working with devices with a higher information density.
- 2) ZIP-BT-NFC is also possible.
- 3) ZTH EU/US/AP is also possible

### Download and install


- [Link.10](#) - (Supports Bluetooth and USB to NFC and MP-Bus)
- [ZK1-GEN](#) (Connecting cable 5 m, A: RJ11 6/4 LINK.10, B: 6-pin for connection to service socket)
- [ZK2-GEN](#) (Connecting cable 5 m, A: RJ11 6/4 LINK.10, B: free wire end for connection to MP/PP terminal)



Most of us spend the majority of our time indoors. Indoor climate is crucial to how we feel, how productive we are and if we stay healthy.

We at Lindab have therefore made it our most important objective to contribute to an indoor climate that improves people's lives. We do this by developing energy-efficient ventilation solutions and durable building products. We also aim to contribute to a better climate for our planet by working in a way that is sustainable for both people and the environment.

[Lindab](#) | For a better climate